


**WET SIEVE ANALYSIS
TEST REPORT**



Project : Reference Test
 Location : Hawkes Bay
 Client : J.Bishop, P.O Box 13044, Mahora, Hastings
 Contractor : Awakeri Drainage Ltd
 Sampled by : Wayne
 Date sampled : 26/11/21
 Sampling method : Client sampled
 Sample description : Gravel - AP 40
 Sample condition : Tested as received

Project No : 2-L0175.12
 Lab Ref No : NA5100.A
 Client Ref No : AS40B

Sieve Analysis							
Size (m m)	% Passing	Size (m m)	% Passing	Size (m m)	% Passing	Size (m m)	% Passing
75.00	-	19.00	81	4.75	47	0.425	-
63.00	-	13.20	72	2.36	38	0.300	21
37.50	100	9.50	64	1.18	31	0.150	15
26.50	92	6.70	55	0.600	25	0.075	9

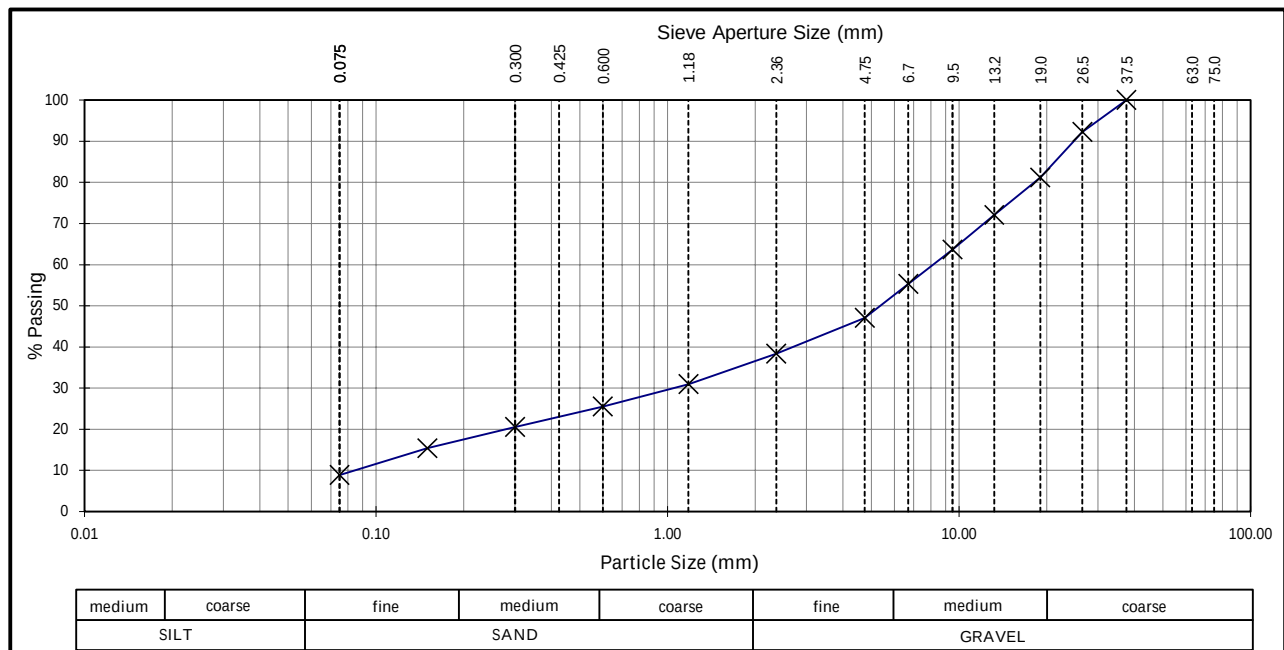

Test Method	Notes
NZS 4407 : 2015 Test 3.8.1	History: Ex Awakeri Yard (Richmond Rd) Fraction tested: Whole Dispersant Used: Nil Fraction passing finest sieve is by difference.

Date tested : 20/12/21

Date reported : 24/12/21

This report may only be reproduced in full

Approved A.Ching

Designation : Laboratory Manager

Date : 24/12/21