


PARTICLE SIZE DISTRIBUTION - DRY SIEVE



SITE: Awakeri Drainage, 32 Richmond Road, Tomoana, Hastings
 CLIENT: Awakeri Drainage Ltd
 LOCATION: AP65 Stockpile
 SAMPLED BY: NG
 TESTED BY: NG
 DATE: 25 January 2023
 TEST METHOD: Dry Sieve (NZS4402:1986, Test 2.8.2)
 MATERIAL DESC.: Silty GRAVEL

Report Number: LAB23/002
 Page: 1 of 1

RESULTS

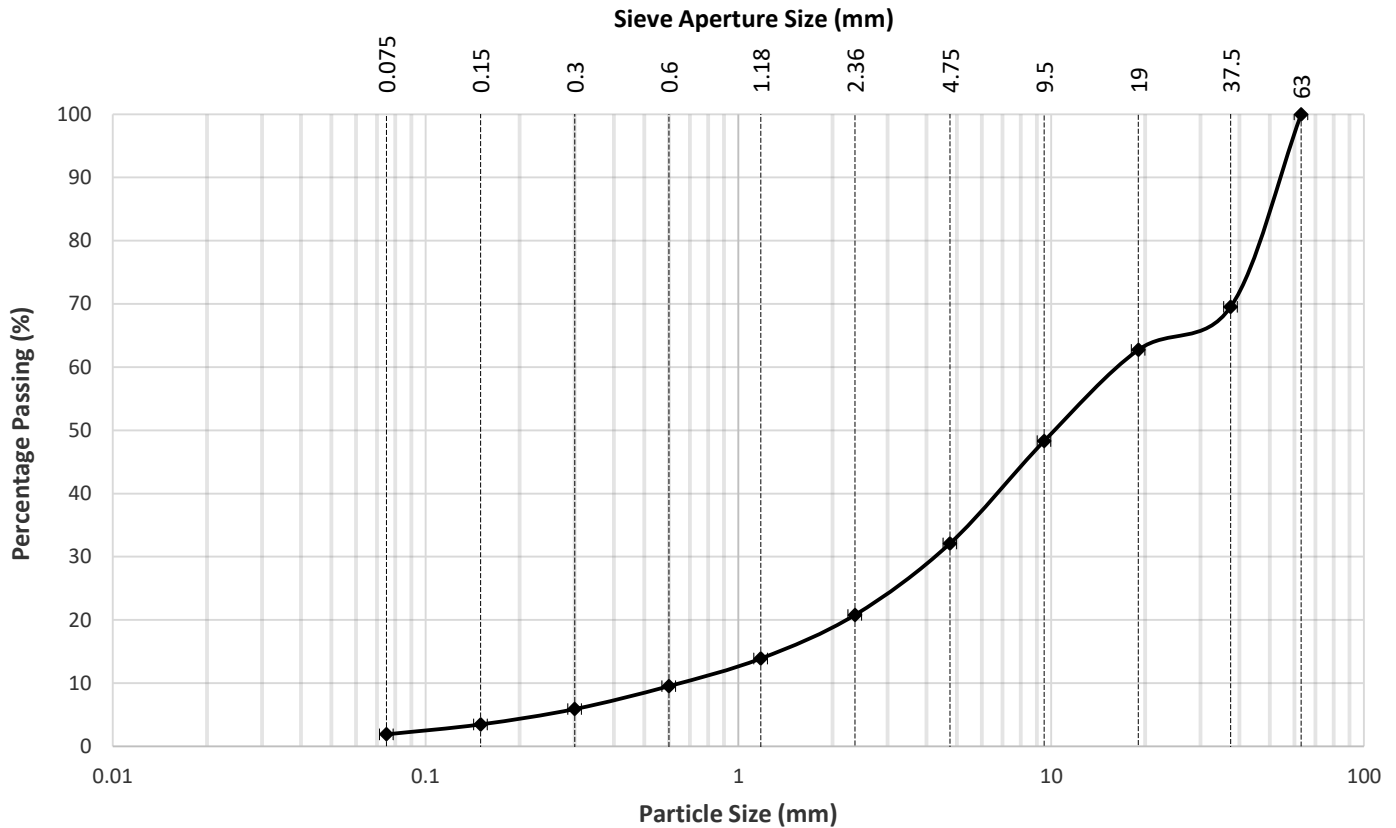

	fine	medium	coarse	fine	medium	coarse
SILT and CLAY	SAND			GRAVEL		

Sieve Size (mm)	63	37.5	19	9.5	4.75	2.36	1.18	0.6	0.3	0.15	0.075	Loss
Percentage Passing (%)	100	69.5	62.7	48.3	32.1	20.8	13.9	9.5	5.9	3.5	1.9	-0.09

Comments:

Test Method: NZS 4402:1986, Test 2.8.2 "Determination of particle size distribution-dry sieving"

Report written: NG 25 January 2023
 Report reviewed by: JP 27 January 2023
 Approved for issue: 27 January 2023

Distribution: 1 Awakeri Drainage Ltd
 2 Civil Services (HB) Ltd